


Протокол № 1/11.12.2023

Измерване съпротивлението на почвата

MC-2	Meter: AEMC 6470B Digital Ground Resistance Tester	Meter Serial No. : 244874 JADV
------	--	--------------------------------

Location GPS Coordinates		Electrode	Scale	Meter	Apparent	Layer Resistivity	Layer
Northing	Easting	Spacing (m)	Factor (m)	Reading (Ω)	Resistivity ($\Omega.m$)	Barnes Method of Calculation Resistivity ($\Omega.m$)	
43°45'48.87"	27°45'14.79"	1.0	6.28	6.508	40.891	40.891	0 m - 1 m
		2.0	12.57	3.264	41.015	41.141	1 m - 2 m
		3.0	18.85	2.200	41.460	42.379	2 m - 3 m
		4.0	25.13	1.666	41.880	43.193	3 m - 4 m
		5.0	31.42	1.375	43.197	49.412	4 m - 5 m

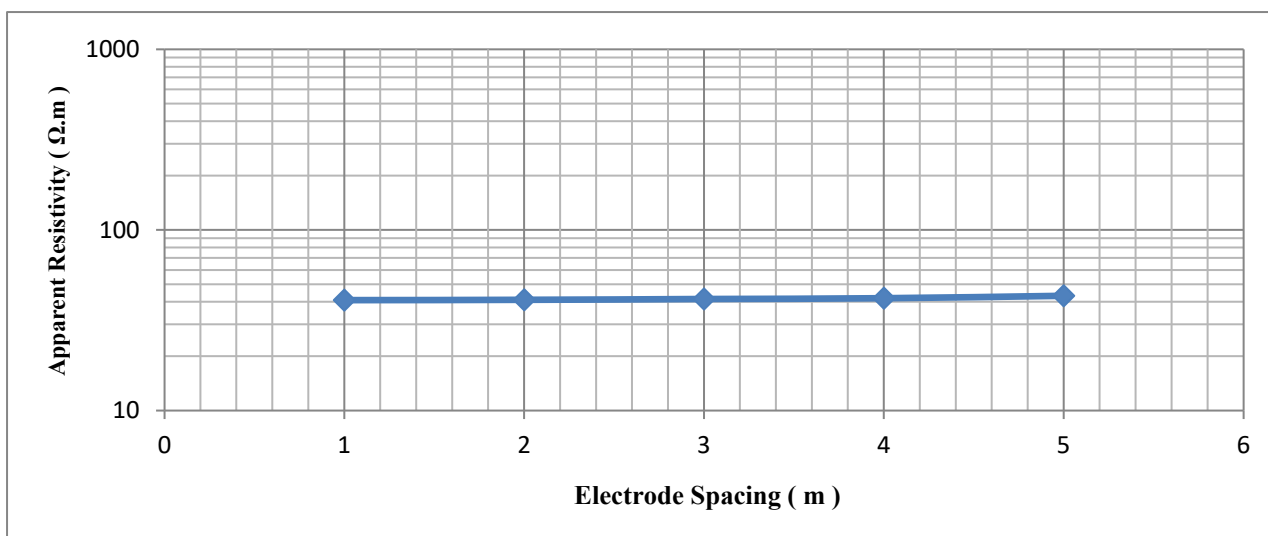

Протокол № 2/11.12.2023

Измерване съпротивлението на почвата

MC-3	Meter: AEMC 6470B Digital Ground Resistance Tester	Meter Serial No. : 244874 JADV
------	--	--------------------------------

Location GPS Coordinates		Electrode Spacing (m)	Scale Factor (m)	Meter Reading (Ω)	Apparent Resistivity ($\Omega.m$)	Layer Resistivity Results Barnes Method of Calculation Resistivity ($\Omega.m$)	Layer
Northing	Easting						
43°48'35.82"	27°46'55.74"	1.0	6.28	6.156	38.680	38.680	0 m - 1 m
		2.0	12.57	1.920	24.127	17.531	1 m - 2 m
		3.0	18.85	1.230	23.185	21.505	2 m - 3 m
		4.0	25.13	0.990	24.881	31.879	3 m - 4 m
		5.0	31.42	0.800	25.133	26.191	4 m - 5 m

